

S3-105 /S3-150NV 105kW & 150kW Three Phase Power Controller



The Spectral range of S3 thyristor power controllers are designed for the control of resistive loads in electric furnaces, and heater batteries in HVAC systems. The S3 series, like all Spectral controllers uses zero crossover switching, and burst pulse control ensures the load is switched only in multiples of complete mains half cycles thus keeping supply and electrical disturbance to a minimum. Variable frequency PWM provides near infinite resolution.

Features

- 0 – 10V Input Control
- 105kW & 150kW
- PWM Control
- Zero Cross Over Switching
- Self Powered
- IP20 Enclosure
- CE Compliant
- BSEN50178 Build Standard

Specifications and Characteristics

Type Number	S3-105NV	S150NV
Total Rating (kW)	105	150
Maximum Current rms (A)	146	209
Supply Voltage (Vac)	415 -15+10%	
Frequency (Hz)	50 - 60	
Power Supply	Line / Self Powered	
Controlled Arms	Two	
Cooling	Natural Air Convection	
Fuse Type	315FM	315FM
Terminal mm ²	35	70
Input Signal (Vdc)	0-10	
Input Impedence (ohms)	47K	
Cycle Time (S)	0.5 to 8	
Isolation (V)	4000	
Operating Temperature (°C)	-10 to + 40	
De rating	20% at 50°C	
Dimensions (mm) H	250	230
W	250	345
D	155	222

OPERATION

This power controller is designed to regulate a resistive load by switching the load on and off in time proportioned bursts according to the incoming dc signal (Factory set 0-10Vdc).

LOCATION

Install power controller with heatsink fins in the vertical plane. Allow a minimum of 100mm clearance top and bottom. Control panels should have sufficient ventilation to maintain the ambient temperature through the thyristor unit to below 40 Degrees C to run unit to specified kW rating.

SAFETY

It is essential to fit a safety device that will disconnect the mains supply from the Spectral controller in case the heating element overheats. This can be a suitably rated contactor or circuit breaker. It is also recommended to fit suitably rated fuses for cable protection (the on board fuses are for controller protection only

FUSES

Where power controllers are fitted with ultra-fast fuses to protect the semiconductors replacements should be of exactly the same type and should be purchased via your supplier. External fuses may be fitted where not provided.

INPUT SIGNAL

These power controllers accept 0 – 10Vdc input signal from a BEMS or controller which will regulate the current to the load in order to achieve accurate proportional control. The unit operates on the burst fire zero-voltage switched principle. Zero voltage switching is for minimum RFI. Burst firing for minimum harmonic distortion. The full load is switched on & off in timed bursts and is proportional to the input signal.

INSULATION TESTS

Thyristors can be irreparably damaged by exceeding their specified voltage rating.

It is therefore important to observe proper insulation testing procedures. The thyristors can be effectively isolated from the circuit by shorting together the line and load terminals. This will protect them from damage due to possible over-voltage caused by the insulation test procedure. The insulation test can then be carried out by applying the test voltage between the line terminals and earth.

Please contact Spectral Limited if any additional information on this procedure is required.


INSTALLATION

Spectral controllers are designed as plug and play. Refer to wiring diagram supplied with the controller for correct installation. Before commissioning ensure that ALL power connections are tightened correctly.

It is highly recommended that only a qualified electrician carry out testing due to potentially lethal high voltages associated with this task

Spectral S3 Series

Typical Installation Three Phase

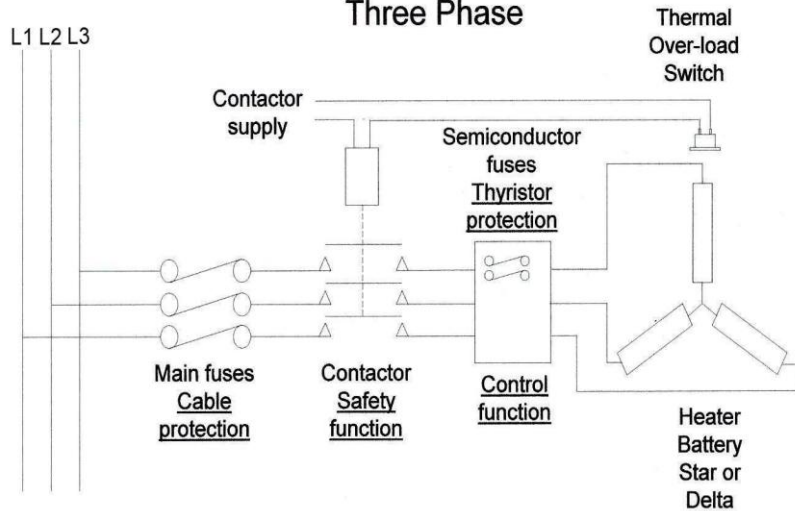

Input Configuration

